-	9
Scale: NO SCALE	M-501

-	8
Scale: NO SCALE	M-501

-	7
Scale: NO SCALE	M-501

-	6
Scale: NO SCALE	M-501

SEQUENCE OF OPERATIONS:
UPON ACTIVATION OF THE KITCHEN HOOD ANSUL SYSTEM, THE DRY CONTACT WITHIN THE HOOD CONTROL PANEL SHALL OPEN AND SEND A CONTROL SIGNAL FOR ROOFTOP UNIT SHUTDOWN. SHUTDOWN SHALL OCCUR VIA AN ISOLATION RELAY TO THE (3) ROOFTOP UNITS SUPPLYING MAKE-UP AIR TO THE HOOD. E.C. TO PROVIDE CABINET, RELAY, TRANSFORMER AND ALL NECESSARY CONDUIT AND WIRING IN ORDER TO PROVIDE A, COMPLETE, FULLY FUNCTIONING SYSTEM.

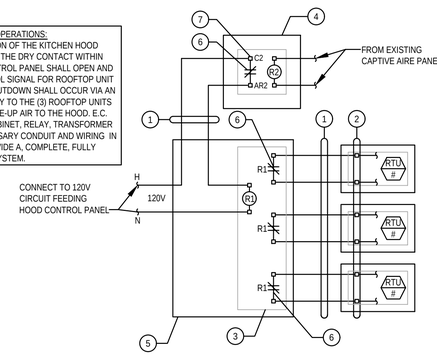

LEGEND

1. (2) #12 CONTROL WIRES IN 1/2" CONDUIT BY E.C.
2. M.C. TO CONNECT INTO REMOTE UNIT SHUTDOWN TERMINAL ON CARRIER ROOFTOP UNIT CONTROL BOARD AND REMOVE JUMPER. REFER TO MANUFACTURER FOR ADDITIONAL INFORMATION.
3. DPDT 120V RATED RELAY BY E.C. ENERGIZE FOR FAILSAFE OPERATION.
4. HOOD CONTROL PANEL AT KITCHEN.
5. 12X12X6 NEMA 1 CABINET MOUNTED ON WALL ADJACENT TO KITCHEN HOOD BY E.C.
6. N.O. DRY CONTACT (SHOWN ENERGIZED) THAT OPENS IN FIRE CONDITIONS.
7. 120V RATED DRY CONTACT WITHIN CAPTIVE AIRE PANEL.

RTU CONTROL WIRING DIAGRAM 5

Scale: NO SCALE M-501

-	4
Scale: NO SCALE	M-501

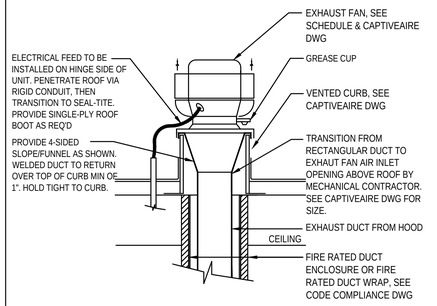

GREASE EXHAUST FAN DETAIL 3

Scale: NO SCALE M-501

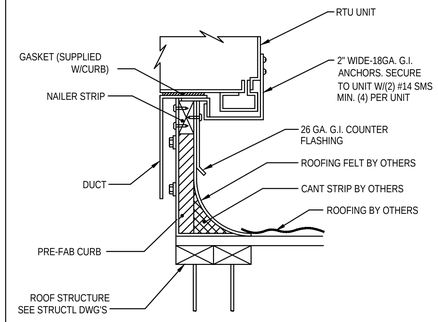

RTU UNIT CURB DETAIL 2

Scale: NO SCALE M-501

-	1
Scale: NO SCALE	M-501

PANDA RESTAURANT GROUP INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1	CHECK SET	06-18-19
2	PERMIT SET	03-23-20
3	BID SET	01-04-21

DRAWN BY: JAD / DJM

PANDA PROJECT #: S4-19-D6240
ARCH PROJECT #: P7331

cph
www.cphcorp.com
A Full Service A & E Firm
Plans Prepared By:
CPH, Inc.
500 West Fulton St.
Sanford, Fl. 32771
Ph: 407.322.6841
Licenses:
Eng. C.O.A. No. 3215
Survey L.B. No. 7143
Arch. Lic. No. AA2600926
Lndscp. Lic. No. LC0000298

JEFFREY ALAN DEAL
LICENSE
No. 87451
STATE OF FLORIDA
PROFESSIONAL ENGINEER
2021/1/04

PANDA EXPRESS

END CAP - TENANT BUILD OUT
5750 NW 183RD ST
HIALEAH, FL 33015

M-501

MECHNICAL DETAILS